

# Tuning of SVC Stabilizers over a Wide Range of Load Parameters Using Pole-Placement Technique

K. Ellithy

Department of Electrical Engineering, Qatar University, Doha, Qatar

Received 19 November 2006; accepted 1 April 2007

## توليف المثبت ذو معوض الفولت الأمبير الفعال المستقر لقيم مختلفة من الاعمال باستخدام تقنية وضع الاقطاب

خالد الليثي

**الخلاصة:** تدرس هذه المقالة تأثير القيم المختلفة في نماذج الاعمال على ضبط المثبت (Stabilizers Tuning) الخاص بمعوض القوى الغير الفعالة الاستاتيكي. وقد تم استخدام نوعية التحكم المبني على التناسب و التكامل حيث يتم ضبط معاملاتهما باختيار اماكن اقطاب النموذج (Pole Placement) في الاماكن التي تؤدي الى تحسين الاخضاع في نظم القوى (Damping of Power Systems) وفي العاده تتم هذه الدراسة بفرض ان الاحمال معتمدة على الجهد. بيد انه يجب الاخذ في الاعتبار ان الاحمال تتصرف بطريقة غير محددة. مما يؤدي الى انحراف الضبط وبالتالي يسبب ضعف اداء المتحكم ذو المعاملات الثابتة مع وجود احمال ذات متغيرات اخرى بل قد يؤدي الى عدم استقرار عند بعض الاحمال. وتقدم المقالة دراسة لتأثير قيم المتغيرات في نماذج الاعمال على ضبط قيمة معاملات التحكم في معوض القوى الغير الفعالة الاستاتيكي المبني على التناسب و التكامل وتبين الدراسة ان لها تأثير كبير. وقد تم دراسة اداء النظام مع الوقت حيث تم بيان ان المتحكم ذو المعاملات الثابتة يقلل ادائة عند تغير الاحمال كما انه قد يسبب عدم استقرار عند بعض الاحمال.

**المفردات المفتاحية:** قيم نماذج الاعمال، توليف مثبتات معوض القوى الغير الفعالة الاستاتيكي - وضع الاقطاب.

**Abstract:** This paper investigates the effect of typical load model parameters on the static var compensator (SVC) stabilizers tuning. A proportional-Integral (PI) type stabilizer is considered and its gain-settings are tuned using the pole-placement technique to improve the damping of power systems. Tuning of SVC stabilizers (damping controllers) traditionally assumes that the system loads are voltage dependent with fixed parameters. However, the load parameters are generally uncertain. This uncertain behavior of the load parameters can de-tune the gains of the stabilizer; consequently the SVC stabilizer with fixed gain-settings can be adequate for some load parameters but contrarily can reduce system damping and contribute to system instability with loads having other parameters. The effect of typical load model parameters on the tuning gains of the SVC PI stabilizer is examined and it is found the load parameters have a considerable influence on the tuning gains. The time domain simulations performed on the system show that the SVC stabilizer tuned at fixed load parameters reduce the system damping under other load parameters and could lead system instability.

**Keywords:** Load model parameters, SVC stabilizer, Pole-placement

## 1. Introduction

Studies and experience have shown that load model parameters can have a significant effect on the results of dynamic performance and voltage stability of power systems (Millanovic, *et al.* 1995; Langevin, *et al.* 1986; Ellithy, *et al.* 1989; Choudhry, *et al.* 1990; Choudhary, 1986; Ellithy, *et al.* 1997 and Craven, *et al.* 1983; Xu, *et al.* 1994, Vaahedi, *et al.* 1988; Alden, *et al.* 1976; Ellithy, *et al.* 1997). Incorrect parameters of a load model could lead to a power system operating in modes that result in actual system collapse and separation (Craven, *et al.* 1983; Xu, *et al.* 1994). Accurate load model parameters are, therefore, necessary to allow more precise calculations of power system control and stability limits which are critical in the planning and operation of a power

system dynamics has long been recognized, and it has become clear that assumptions regarding load model parameters can impact predicted system performance. Several efforts have been devoted to load modeling and evaluation of load parameters through field measurements (Xu, *et al.* 1997; Ohyama, *et al.* 1985). Analytical approaches to constructing accurate load models have also been considered (Xu, *et al.* 1997; Berg, *et al.* 1973). Voltage-dependent load models for composite load representation are highly recommended by the IEEE working group (IEEE Task Force for Dynamic Performance, 1995) and many utilities (Xu, *et al.* 1997; Ohyama, *et al.* 1985; Concordia, *et al.* 1982).

Flexible AC Transmission System (FACTS) controllers based on thyristor controlled reactors (TCRs), such as static var compensators (SVCs) (IEEE Special Stability Control Working group, 1994) are being used by several

utilities to support the voltage and to increase the capacity of their systems. SVCs with additional signals (stabilizing signals) in their voltage control loops have been used to improve the damping of power system electromechanical oscillations and to enhance system stability. The additional signals that are generally used in stabilizers (damping controllers) are rotor speed and bus frequency deviations. In recent years, many designs for SVC stabilizers have been proposed to damp out the electromechanical oscillation mode in power systems (Cheng, *et al.* 1992; Hsu, *et al.* 1988; Lee, *et al.* 1994; Hamoud, *et al.* 1987; El-Saady, *et al.* 1998; Hammad, *et al.* 1984; El-Metwally, *et al.* 2003; Fang, *et al.* 2004; Yu, *et al.* 2001; Farsangi, *et al.* 2004). The basic limitation of these designs and/or tuning of SVC stabilizers are that the influence of load model parameters has not been taken into account. Almost all of these SVC stabilizers is based on a constant impedance load (fixed load parameters). The constant impedance load representation is not accurate and is not a good approximation in view of the strong influence of the load voltage sensitivity on the dynamic performance of the power system. The parameters of typical loads vary seasonally, and in some cases change over day. Consequently, the SVC stabilizers tuned under constant impedance load model may become unacceptable under other load-model parameters.

The subject of this paper is to investigate important aspects related to the effect of loads and their parameters uncertainty on tuning of SVC stabilizers. The author has initially addressed this problem in (Ellithy, *et al.* 1989; Choudhry, *et al.* 1986). Proportional-integral (PI) type stabilizer is considered as the additional stabilizer with the SVC. The gain-settings of SVC PI stabilizer are determined using pole-placement (eigenvalue-placement) technique to improve the damping of electromechanical oscillations mode in power systems. The interaction between typical load parameters and the tuning gains of the SVC stabilizer is investigated. Finally, the time domain simulations of the system under disturbance conditions are performed to demonstrate the effect of the load parameters on tuning of the SVC PI stabilizer.

## 2. Power System under Study

The power system under study is a synchronous generator connected to a large power system, of which the single-line diagram is shown in Fig. 1. The generator is equipped with IEEE type-1 excitation system. Full order model (7<sup>th</sup> order model) of the generator is utilized in the analysis and simulations. The load is connected at a generator terminal and the SVC is connected at the mid-point of transmission line. The system parameters and nominal operating point values are given in Appendix.

### 2.1 Model of SVC with Additional Stabilizer

The thyristor-controlled reactor (TCR) type SVC (Chang, *et al.* 1992; Lee, *et al.* 1988; IEEE Special Stability Control Working Group 1994; El-Metwally, *et al.* 2003), shown in Fig. 1, is used in the present study.

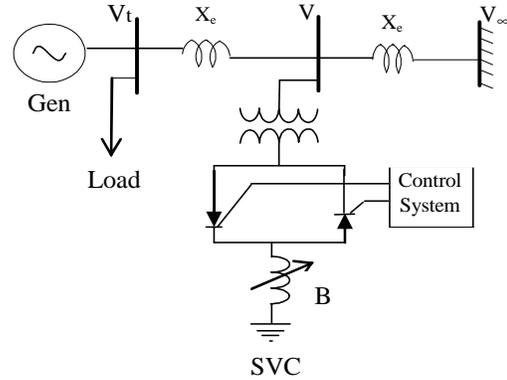


Figure 1. Power system single-line diagram

The model of the SVC with additional proportional-integral (PI) stabilizer is shown in Fig. 2. The stabilizer uses the generator speed deviation ( $\Delta\omega$ ) as a feedback signal to generate the auxiliary stabilizing signal  $\Delta V_s$  (a stabilizer output signal) to the SVC. The signal  $\Delta V_s$  is added to the main input of the SVC to damp out the electromechanical oscillations mode. The signal  $\Delta V_s$  causes fluctuations in the SVC susceptance and, hence, in the bus voltage. If the SVC stabilizer is tuned correctly the voltage fluctuations act to modulate the power transfer to damp out the electromechanical oscillations mode. The equation of the SVC controller (Fig. 2) is given by

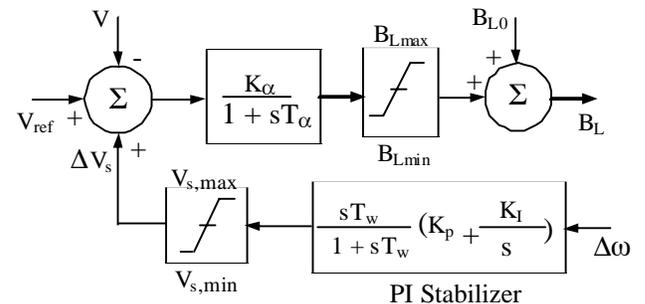


Figure 2. Block diagram of SVC with PI stabilizer

$$\Delta B_L = \frac{K_\alpha}{1 + sT_\alpha} (\Delta V_s + V_{ref} - V) \quad (1)$$

where the auxiliary stabilizing signal (SVC stabilizer output signal)  $\Delta V_s$  is given as

$$\Delta V_s = \left( \frac{sT_w}{1 + sT_w} \right) \left( K_p + \frac{K_I}{s} \right) \Delta\omega \quad (2)$$

where  $K_p$  and  $K_I$  are the SVC stabilizer gain settings. The firing control system of the thyristors is represented by a single time constant  $T_\alpha$  and gain  $K_\alpha$ . The wash out circuit is introduced in the stabilizer to assure no permanent effect in the terminal voltage due to a prolonged error in the low frequency that might occur in an overload and to assure that the wash out circuit will not have any effect on the phase shift or gain on the low frequency.

The variable inductive susceptance  $B_L$  of SVC is a function of the thyristor firing angle  $\alpha$  and is given by

$$B_L = -\frac{(2\pi - 2\alpha + \sin 2\alpha)}{\pi x_s} ; \pi/2 \leq \alpha \leq \pi \quad (3)$$

where  $x_s$  is the reactance of the SVC fixed inductor.

## 2.2 Load Model

This paper follows the recommendation of the IEEE working group (IEEE Task Force on Load Representation for Dynamic performance 1995) and utilities (Xu, *et al.* 1997; Ohyama, *et al.* 1985) in utilizing the voltage-dependent load model for composite load representation. Utilities normally perform field tests, or in some cases perform regression analysis to establish system load models to be used for power-flow and stability studies. These models are in the form of

$$P_L = P_{L0} \left( \frac{V_t}{V_{t0}} \right)^{n_p} \quad Q_L = Q_{L0} \left( \frac{V_t}{V_{t0}} \right)^{n_q} \quad (4)$$

where

$P_L$  and  $Q_L$  are the load active and reactive power;

$V_t$  is the load bus voltage;

$n_p$  and  $n_q$  are the load parameters.;

$P_{L0}$ ,  $Q_{L0}$ , and  $V_{t0}$  are the nominal value of load active power, load reactive power, and bus voltage prior to a disturbance.

For small disturbance studies of system damping, the linearized version of Eq. (4) is given by

$$\Delta P_L = n_p \frac{P_{L0}}{V_{t0}} \Delta V_t \quad \Delta Q_L = n_q \frac{Q_{L0}}{V_{t0}} \Delta V_t \quad (5)$$

where

$$\Delta V_t = \frac{1}{V_{t0}} (V_{q0} \Delta V_q + V_{d0} \Delta V_d)$$

The load representation given in Eq. (4) makes it possible the modeling of all typical voltage-dependent load models by selecting appropriate values of the load parameters  $n_p$  and  $n_q$ . The values of  $n_p$  and  $n_q$  depend on the nature of the load and can vary between 0 to 3.0 for  $n_p$  and 0 to 6.0 for  $n_q$ . The load parameters of the composite load (industrial, commercial and residential loads) can be determined by the following equations (Ohyama, *et al.* 1985; Berg 1973):

$$n_p = \sum_{i=1}^n n_{pi} \left( \frac{P_{li}}{P} \right); \quad P = \sum_{i=1}^n P_{li} \quad (6)$$

$$n_q = \sum_{i=1}^n n_{qi} \left( \frac{Q_{li}}{Q} \right); \quad Q = \sum_{i=1}^n Q_{li}$$

where  $P_{li}$  and  $Q_{li}$  are the active and reactive power of  $i$ th component and  $n_p$ ,  $n_q$  are their load parameters. The measurement values of the parameters ( $n_p$ ,  $n_q$ ) of various kinds of typical power system composite loads are reported in (Xu, *et al.* 1997; Ohyama, *et al.* 1985; Concordia, *et al.* 1982).

## 3. Design of SVC PI Stabilizer

The gain-settings ( $K_p$  and  $K_I$ ) of the SVC PI stabilizer are determined using the pole placement by moving the

eigenvalues associated with the electromechanical oscillations mode to a prescribed value on the left-half complex plane. It is well known that improving the damping of these oscillations mode can enhance the damping characteristic of a power system. The design procedures and their associated results are given below.

### 3.1 System without SVC Stabilizer

In the design of the SVC stabilizer using the pole-placement technique, the nonlinear equations of the power system are first linearized around an operating point to obtain the state-variables model of the system. In the present study, the state-variables model of the system is obtained using the component connection model (CCM) technique (Ellithy, *et al.* 1989; Choudhry, *et al.* 1986). The equations describe the state-variable model given in (El-Metwally, *et al.* 2003).

The state-variables model of the system is expressed as

$$\frac{dX}{dt} = AX + BU \quad Y = CX \quad (7)$$

where

$$X = (\Delta i_q \Delta i_d \Delta i_q \Delta i_{kkq} \Delta i_{kkd} \Delta i_{fd} \Delta \delta \Delta \omega \Delta V_F \Delta E_{fd} \Delta V_R \Delta B_L)^T$$

is the state-variables vector. The state variables  $X_1$  to

$X_7$  correspond to the generator,  $X_8$  to  $X_{11}$  correspond

to the excitation system and  $X_{12}$  corresponds to the SVC.

$Y = \Delta \omega$ , the output signal.

$U = \Delta V_s$ , the control signal (stabilizer output signal) to the SVC.

The system eigenvalues without SVC PI stabilizer (open-loop system) for fixed load parameters  $n_p = n_q = 2$  (constant impedance load) are listed in the first column of Table 1.

**Table 1. System eigenvalues at load model parameters  $n_p = n_q = 2$**

	Without SVC Stabilizer ( $K_p=0.0, K_I=0.0$ )	With SVC Stabilizer ( $K_p=19.892, K_I=178.895$ )
$\lambda_{1,2}$	-212.210 ± j842.990	-212.700 ± j842.930
$\lambda_3$	-98.782	-89.620
$\lambda_4$	-72.361	-79.480
$\lambda_5$	-38.992	-38.820
$\lambda_{6,7}$	-0.679 ± j11.362	-2 ± j11*
$\lambda_{8,9}$	-9.893 ± j14.903	-9.070 ± j14.630
$\lambda_{10,11}$	-0.645 ± j0.837	-0.650 ± j0.900
$\lambda_{12}$		-10.220

\*: Exact pole placement

The eigenvalues associated with the electromechanical oscillations mode of the synchronous generator are depicted by the complex pair eigenvalues  $\lambda_{6,7}$ . The damping ratio  $\zeta$  of this poorly damped oscillations mode without the SVC stabilizer ( $\lambda_{6,7} = \sigma \pm j\beta = -0.67896 \pm j11.362$ ) is given as

$$\zeta = \frac{\sigma}{\sqrt{\sigma^2 + \beta^2}} \times 100 = 6\%$$

The damping ratio  $\zeta = 6\%$  for the electromechanical mode is not good enough. The poor damping of this mode can be also seen from the system time response in Figs. 3 and 4. The eigenvalues for this mode should be shifted to more desirable locations by the SVC stabilizer (*ie.* the SVC stabilizer is needed to improve the damping of this mode). The tuning gains of the SVC stabilizer are described in the following section.

### 3.2 Determination of SVC Stabilizer Gains using Pole Placement Technique

The gain-settings ( $K_P$  and  $K_I$ ) of the SVC stabilizer will be determined to improve the damping ratio of the electromechanical mode by shifting the eigenvalues  $\lambda_{6,7}$  to desired locations. An expression for the gains has been derived by the author in Ellithy (1997) and is given by

$$K_1 = \frac{b_2}{ga_{22}} - \frac{a_{21}b_1}{ga_{11}a_{22}}; \quad K_P = \frac{b_1}{a_{11}} - \frac{K_I a_{12}}{a_{11}}$$

where:

$$g = 1 - \frac{a_{21}a_{12}}{a_{21}^2}; \quad b_1 = \frac{(\text{real part}(h))}{s} \quad (8)$$

$$b_2 = \frac{(\text{imaginary part}(h))}{s}$$

$$m = 1 - \sigma T_\omega; \quad a_{11} = \beta^2 T_\omega - \sigma m; \quad a_{12} = m;$$

$$a_{22} = -\beta m - \alpha \beta T_\omega; \quad a_{22} = \beta T_\omega; \quad h = \frac{1}{d}$$

$$s = \frac{T_\omega}{(m^2 + \beta^2 T_\omega^2)}$$

$\lambda_6 = -\sigma - j\beta$  is the desired eigenvalue location associated with the electromechanical oscillations mode.

$$D = c [\lambda_6 I - A]^{-1} B$$

where  $A$ ,  $B$  and  $C$  system matrices are given in (7).

If the eigenvalues  $\lambda_{6,7} = -2 \pm j11$  (*ie.* the damping ratio of the electromechanical mode  $\zeta = 18\%$ ) are selected at the desired locations, then the gains  $K_P$  and  $K_I$  for the SVC stabilizer can be computed using (8). The results are given in Table 1.

The eigenvalues of the closed-loop system (system with the SVC stabilizer) are given in the second column of Table 1. Considerable improvement in the system damping can be expected in view of the closed-loop eigenvalues. The improvement in the damping can also be seen from the system dynamic performance shown in Figs. 3 and 4.

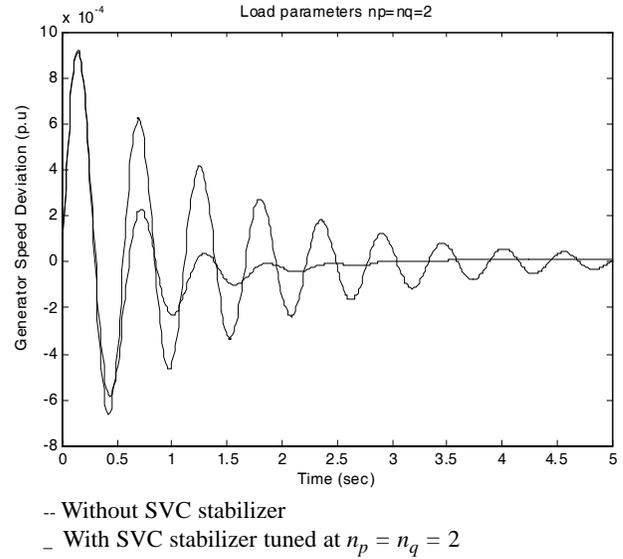


Figure 3. The system dynamic response at load parameters  $n_p = n_q = 2$  for 5% change in  $T_m$


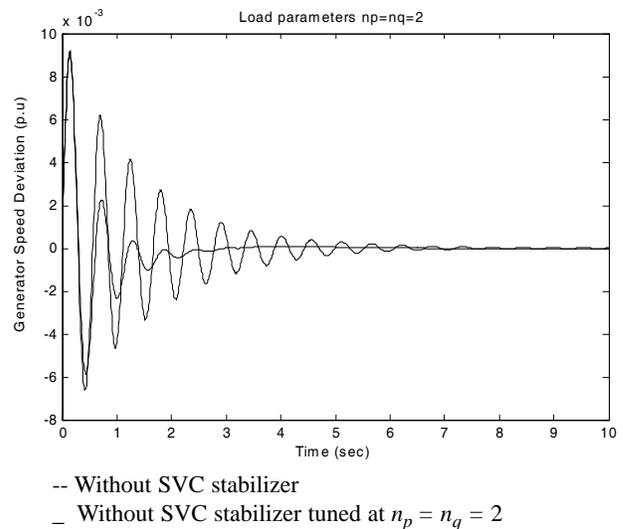


Figure 4. The system dynamic response at load parameters  $n_p = n_q = 2$  for 50% change in  $T_m$


## 4. Effect of Load Parameters on SVC Stabilizer Tuning

The tuned gains ( $K_P=19.892$  and  $K_I=178.895$ ) of the SVC stabilizer at the parameters  $n_p = n_q = 2$  are used to check the damping characteristics and stability of the system under different load model parameters. Based on these fixed gains, tuned at load parameters  $n_p = n_q = 2$ , the damping of the electromechanical oscillations mode is reduced under other load parameters as shown in Figs. 5, 6, 7 and 9. The tuned gains of the SVC stabilizer at other different load parameters are also used to check the system stability under different load parameters. Based on these fixed gains, the system damping is reduced and the system may become unstable under other load param-

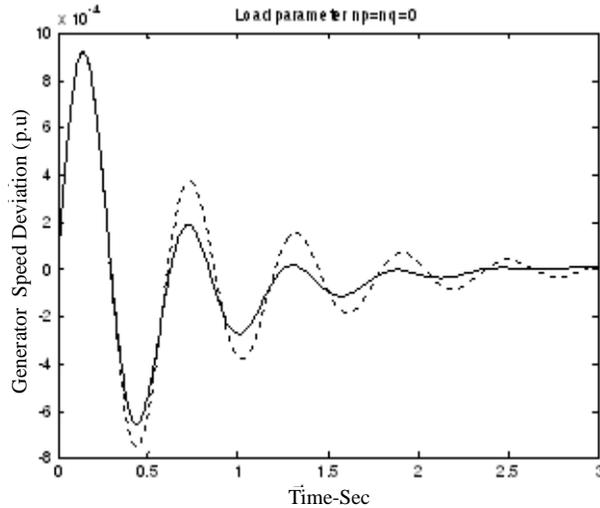

- With SVC stabilizer tuned at  $n_p = n_q = 2$
- With SVC stabilizer tuned at  $n_p = n_q = 0$

**Figure 5. The system dynamic response at load parameters  $n_p = n_q = 0$  for 50% change in  $T_m$**

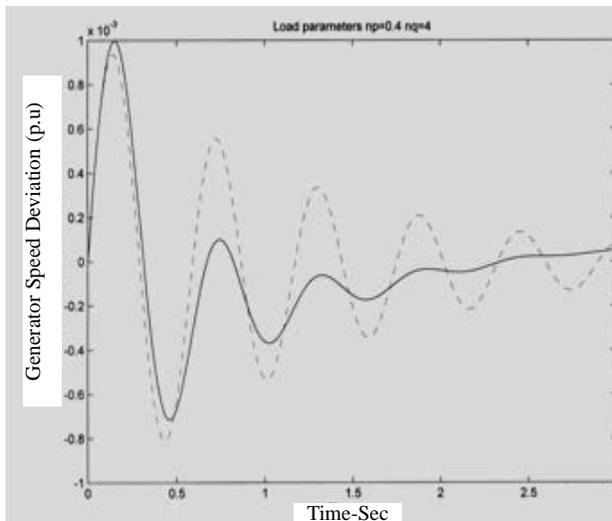


- With SVC stabilizer tuned at  $n_p = n_q = 2$
- With SVC stabilizer tuned at  $n_p = 0.4, n_q = 4$

**Figure 6. The system dynamic response at load parameters  $n_p = 0, n_q = 4$  for 5% change in  $T_m$**


eters as shown in Figs. 8 and 9. The decreases in the system damping are caused by the eigenvalues  $\lambda_{6,7}$ , which are associated with the systems electromechanical oscillations mode.

In order to improve the damping of the oscillations mode (*ie.* improving the damping ratio of the eigenvalues  $\lambda_{6,7}$ ) over a wide range of load model parameters, the SVC stabilizer gains  $K_p$  and  $K_I$  must be tuned. The computed SVC stabilizer gains ( $K_p$  and  $K_I$ ) for typical load model parameters are given in Figs. 10 and 11. These gains have been computed by (8) with the eigenvalues  $\lambda_{6,7}$  fixed at the desired locations of  $-2 \pm j11$ . From these figures, it can be observed that the variations in the load model parameters ( $n_p, n_q$ ) have a considerable influence on the tuning of

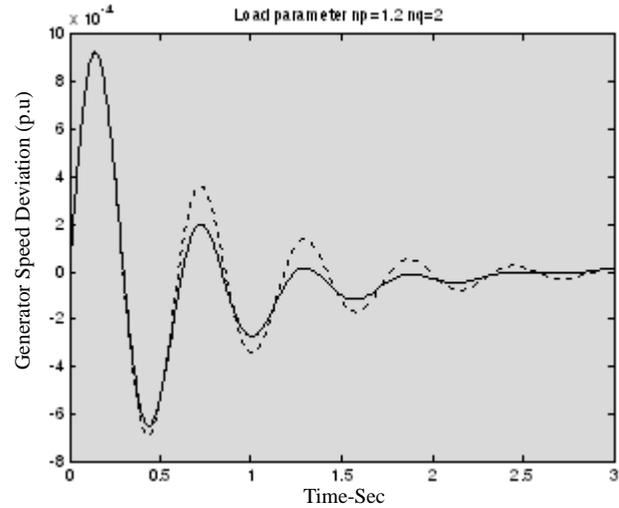

- With SVC stabilizer tuned at  $n_p = n_q = 2$
- With SVC stabilizer tuned at  $n_p = 1.2, n_q = 2$

**Figure 7. The system dynamic response at load parameters  $n_p=1.2, n_q=2$  for 5% change in  $T_m$**

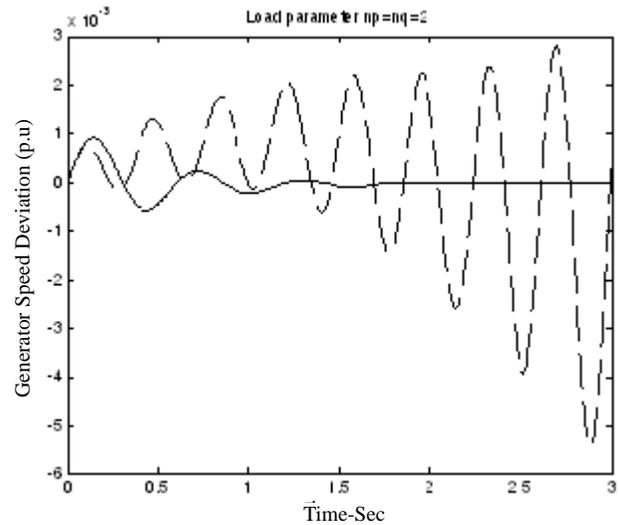


- With SVC stabilizer tuned at  $n_p = 0, n_q = 6$
- With SVC stabilizer tuned at  $n_p = n_q = 2$

**Figure 8. The system dynamic response at load parameters  $n_p = n_q = 2$  for 5% change in  $T_m$**

the SVC stabilizer. While not reported in the paper, the author has also investigated the influence of load parameters when the load is located at the SVC bus. The results obtained indicated no significant departure from the results presented here in so far as the influence of the load parameters on the tuning of the SVC stabilizers.


## 5. Conclusions

This paper has examined the influence of voltage-dependent load models on the effectiveness of the SVC proportional-integral stabilizer for damping the electromechanical oscillations mode in power systems.

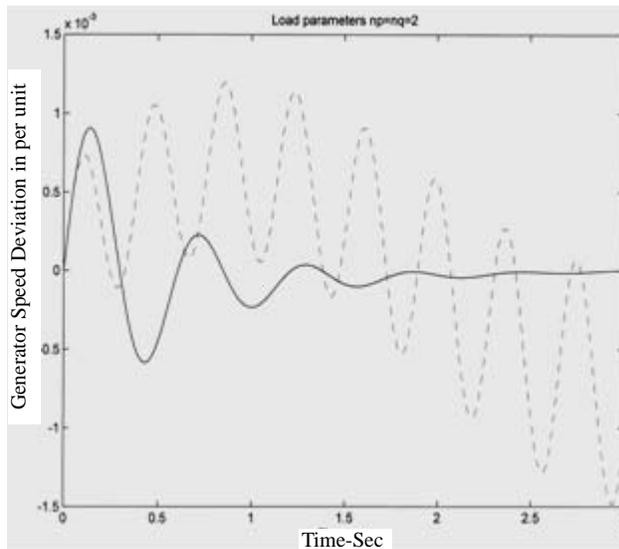


- With SVC stabilizer tuned at  $n_p = 0, n_q = 4$
- With SVC stabilizer tuned at  $n_p = n_q = 2$

**Figure 9. The system dynamic response at load parameters  $n_p = n_q = 2$  for 5% change in  $T_m$**

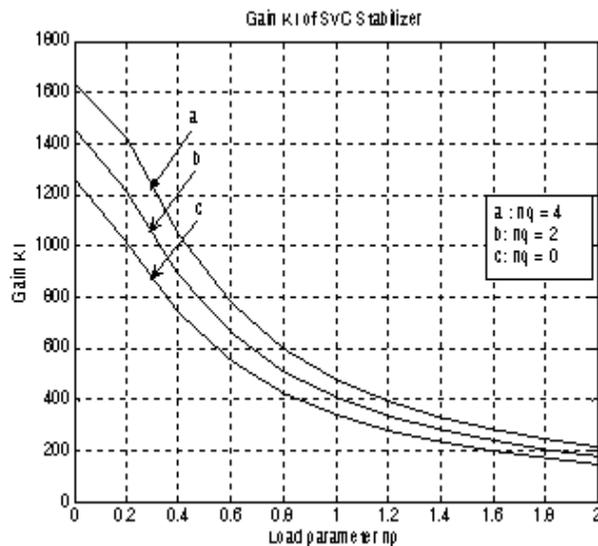

**Figure 10. The computed SVC stabilizer gain  $K_I$  at different load model parameters**

The impact of load model parameters on the SVC stabilizer tuning gains obtained via pole-placement technique is investigated and it is shown that load models have remarkable influence on the stabilizer tuning gains. The results have also shown that the SVC stabilizer tuned gains under specific load parameters could contribute to the worse damping of electromechanical oscillations and reduce system stability under other load parameters. In particular, simulation with constant active power loads shows system instability when the SVC stabilizer is designed assuming constant impedance load. The results presented in this paper reinforce the need for including the load model parameters in the SVC stabilizers tuning for

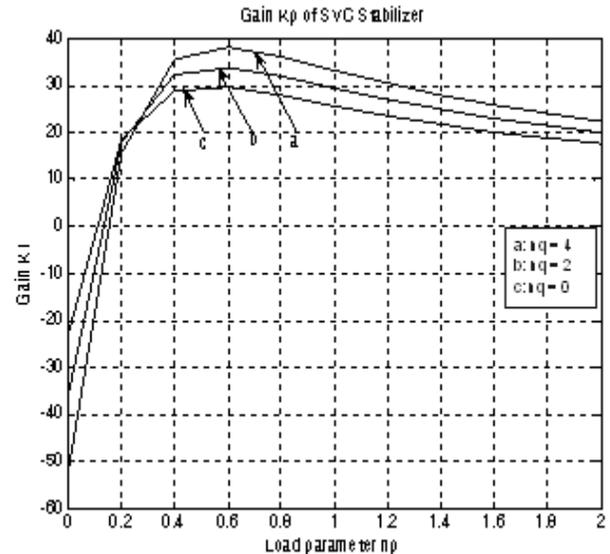

**Figure 11. The computed SVC stabilizer gain  $K_p$  at different load model parameters**

damping the oscillations mode of power systems.

## Acknowledgments

The author would like to thank Qatar University and Qatar Electricity & Water Company (QEWC) for their support.

## References

- Alden, R.T.H. and Zein El-Din, H.M., 1976, "Effect of Load Characteristics on Power System Dynamic Stability," IEEE Trans on Power App. and Syst. Vol. PAS-95, pp. 1762-1768.
- Berg, G.J., 1973, "Power-System Load Representation," Proc. IEE, Vol. 120(3), pp. 344-348.
- Cheng, C.H. and Hsu, Y.Y., 1992, "Damping of Generator Oscillations Using an Adaptive Static VAR Compensator," IEEE Trans. on Power Systems, Vol. 7(2), pp. 718-725.
- Choudhry, M.A., Emarah, A.S., Ellithy, K.A. and Galanos, G.D., 1986, "Stability Analysis of a Modulated AC/DC System Using the Eigenvalue Sensitivity Approach", IEEE Transactions on Power Systems, Vol. PWR-1(2), pp.128-137.
- Choudhry, M.A., Reza, M.A. and Ellithy, K.A., 1990, "Design of a Robust Modulation Controller over a Wide Range of Load Characteristics for AC/DC Systems," IEEE Trans. on Power Systems, Vol. 5(1), pp. 212-218.
- Concordia, C. and Ihara, S., 1982, "Load Representation in Power System Stability Studies," IEEE Trans. on Power App. And Syst, Vol. PAS-101, pp. 969-977.
- Craven, R.H. and Micheal, M.R., 1983, "Load Representation in the Dynamic Simulation of the Queensland Power System", J. of Electrical and Electronics Engineering, Vol. 3(1), pp. 1-7.

- Ellithy, K.A., 1997, "Effect of Voltage Dependent Load Models on Power System Stabilizers Design," Fifth Int. Middle East Power System Conference (MEP-CON'05), Vol. 1, pp. 370-376.
- Ellithy, K.A. and Choudhry, M.A., 1989, "Effect of Load Models on AC/DC System Stability and Modulation Control Design," IEEE Trans. on Power Systems, Vol. 4, pp. 411-418.
- Ellithy, K.A. Al-Alawi, S.M. and Zein El-Din, H.M., 1997, "Tuning Power System Stabilizers Over a Wide Range of Load Models Using an Artificial Neural Network," J. of Engineering and Applied Science, College of Engineering, Cairo University, Vol. 44(2), pp. 389-406.
- El-Metwally, K. and Ellithy, K., 2003, "A Self Organizing Fuzzy Controller for SVC Stabilizers Design in the Presence of Load Characteristics Uncertainty", IEEE International Middle East Power Conference (MEP-CON 2003), Vol. 1, pp. 31-37.
- El-Saady, G., El-Sadek, M. and Abo-Elsaoud, M., 1998, "Fuzzy Adaptive Model Reference Approach-Based Power System Static VAR Stabilizer", Electric Power System Research, Vol. 45, pp. 1-11.
- Fang, D.Z., yang, X., Chung, T.S. and Wong, K.P., 2004, "Adaptive Fuzzy-Logic SVC Damping Controller Using Strategy of Oscillation Energy Descent" IEEE Trans. on Power Systems, Vol. 19(3), pp. 1414-1421.
- Farsangi, M.M., Song, Y.H. and Lee, K.Y., 2004, "Choice of FACTS Device Control Inputs for Damping Interarea Oscillations," IEEE Trans. On Power Systems, Vol. 19(2), pp. 1135-1143.
- Hammad, A.E. and El-Sadek, M., 1984, "Application of a Thyristor Controlled Var Compensator for Damping Subsynchronous Oscillations in Power Systems," IEEE Trans. Power App. And Syst, Vol. PAS-103, pp. 198-212.
- Hamoud, R.M., Irvani, M.R. and Hackam, R., 1987, "Coordinated Static Var Compensators and Power System Stabilizers for Damping Power System Oscillations," Presented at Power Winter Meeting, Paper '87, Vol. WM 045(8), pp. 1059-1067.
- Hsu, Y.Y. and Wu, C.J., 1988, "Adaptive Control of a Synchronous Machine Using the Auto-Searching Method", IEEE Trans. on Power Systems, Vol. 3(4), pp. 1434-1439.
- IEEE Special Stability Controls Working Group 1994, "Static Var Compensator Models for Power Flow and Dynamic Performance Simulation," IEEE Trans. on Power Systems, Vol. 9(1), pp. 229-239.
- IEEE Task Force on Load Representation for Dynamic Performance, 1995, "Bibliography On Load Models For Power Flow and Dynamic Performance Simulation," IEEE Trans. On Power System, Vol. 10(1), pp. 524-538.
- Langevin, M. and Auriol, P., 1986, "Load Response to Voltage Variations and Dynamic Stability," IEEE Trans. on Power Systems, Vol. PWRs-1(4), pp. 112-118.
- Lee, S. and Liu, C.C., 1994, "An Adaptive Output Feedback Static VAR Controller for the Damping of Generator Oscillations," Electric Power System Research, Vol. 29, pp. 9-16.
- Mauricio, W. and Semlyen, A., 1972, "Effect of Load Characteristics on the Dynamic Stability of Power Systems," IEEE Trans. Power App. And Syte, Vol. PAS-91, pp. 2295-2304.
- Milianovic, J.V. and Hiskens, I.A., 1995, "Effect of Load Dynamic on Power System Damping," IEEE Trans. on Power Systems, Vol. 10(2), pp. 1022-1028.
- Ohyama, T., *et al.* 1985, "Voltage Dependence of Composite Load in Power Systems," IEEE Trans. on Power App. and Syst., Vol. PAS-104(11), pp. 3064-3073.
- Xu, W. and Mansour, Y., 1994, "Voltage Stability Analysis Using Generic Dynamic Load Models Load," IEEE Trans. on Power Systems, Vol. 9(1), pp. 479-493.
- Xu, W., Vaahedi, E. Mansour, Y. and Tamby, J., 1997, "Voltage Stability Load Parameter Determination from Field Tests on B.C. Hydro's System," IEEE Trans. on Power Systems, Vol. 12(3), pp. 1290-97.
- Yu, X., Khammash, M. and Vittal, V., 2001, "Robust Design of Damping Controller for Static Compensator in Power Systems," IEEE Trans. on Power Systems, Vol. 16(3), pp. 456-462.
- Zein El-Din, H.M. and Price, W.W., 1988, "Dynamic Load Modeling in Large Scale Stability Studies", IEEE Trans. on Power Systems, Vol. 3(3), pp. 1039-1045.

## Appendix

System parameters and nominal operating values:

### *Synchronous Generator*

$$\begin{array}{lll}
 x_d=1.7 & x_q=1.64 & x_{ls}=0.15 \\
 x_{kkd}=1.605 & x_{kkq}=1.526 & x_{ffd}=1.651 \\
 x_{ad}=1.55 & x_{aq}=1.49 & r_a=0.001096 \\
 r_{fd}=0.000742 & r_{kq}=0.054 & r_{kd}=0.0131 \\
 H=2.37\text{sec}
 \end{array}$$

### *IEEE Type-1 Excitation System*

$$\begin{array}{lll}
 K_A=400 & T_A=0.05 \text{ sec} & K_F = 1.0 \\
 T_F=1.0 \text{ sec} & K_E=-0.17 & T_E= 0.95 \text{ sec}
 \end{array}$$

### *Transmission Line*

$$x_1=0.15 \quad x_2=0.15$$

### *Static Var Compensator (SVC)*

$$\begin{array}{lll}
 K_\alpha=20 & T_\alpha= 0.02 \text{ sec} & X_s = 0.8 \\
 \alpha_o=1400 & B_{LD}=-0.164 & T_w = 0.1 \text{ sec} \\
 V_s \text{ limit} = 0.1
 \end{array}$$

### *Nominal Operating Values*

$$\begin{array}{llll}
 P_G=1.0 & pf_G=0.85 & P_{LD}=1.25 & pf_I=0.5 \\
 V_i=0.976 & V=0.987 & V_\infty=1.0 & \delta_0=43.146^\circ
 \end{array}$$